



Weber Fire District

LP Gas Permit Application

2023 West 1300 North
Farr West, Utah 84015
Office: 801-782-3580

Submission Date: _____

INSTALLATION INFORMATION

PROJECT NAME		CONTACT:
Physical Address:		
Mailing Address:		
Phone:	EMAIL:	<input type="checkbox"/> Tank <input type="checkbox"/> Cabinet – Size:
Service Description:	Type of Vehicle Protection:	
<input type="checkbox"/> Above Ground	<input type="checkbox"/> Under Ground	
Foundation, Footing, or Backfill:		


LICENSED LP GAS INSTALLER INFORMATION

Company Name:	
Physical Address:	
Mailing Address:	Phone:
Contact:	EMAIL:

INFORMATION

Information shall include drawings and be submitted by a Utah Licensed LP Gas Installer to the Fire Marshal's Office at: prevention@weberfiredistrict.gov.
Insufficient information may cause a delay or rejection of plans. Plans and permits will not be released until all fees have been paid. Any questions please reach out to 801.782.3580.

SAMPLE DRAWING

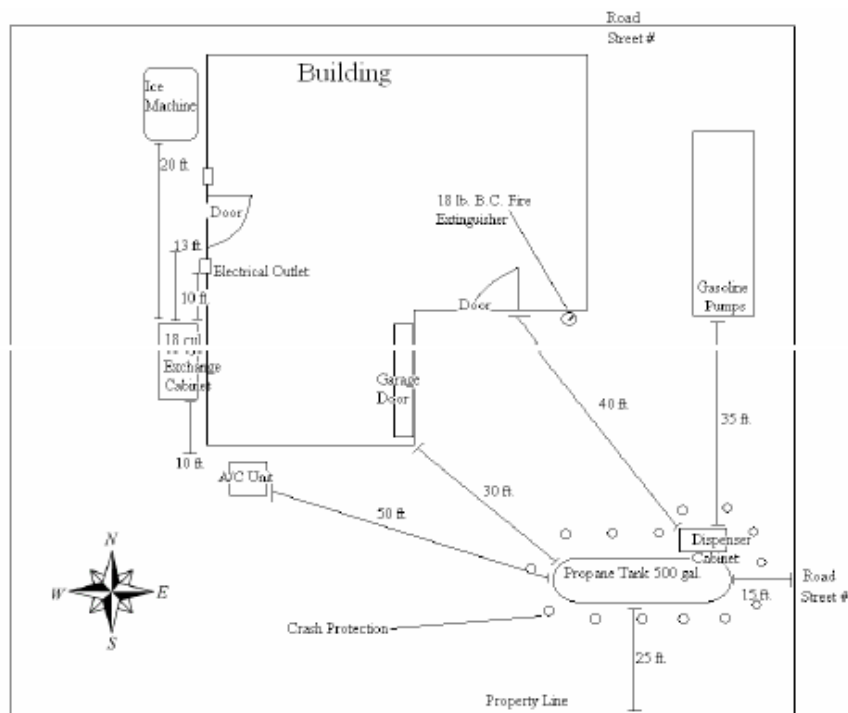

Installation must adhere to **NFPA 58 (2017)**, **IFGC (2018)**, and the **International Fire Code (IFC) (2018 Edition) Chapter 61**.

Approved vehicle protection measures, such as guard posts or other appropriate means must be installed for the tank and piping. Compliant is required with **IFC (2018 Edition) Section 312 and NFPA 58 (2017 Edition)**.

Guard posts must be constructed of steel with a minimum diameter of 4 inches and filled with concrete. Posts should be spaced no more than 4 feet apart, and at least 3 feet deep, in a concrete footing, with a minimum diameter of 15 inches. The top of the posts must be at least 3 feet above the ground and positioned no less than 3 feet from the tank.

A detailed plan for security measures to prevent tampering should be provided.

A fire extinguisher with a **minimum of 18 lb. B.C.** must be located within 75 feet of dispenser.

Clear and visible signage must be posted, including **No smoking, Propane, and Flammable Gas**.



PLAN REVIEW DRAWING INSTRUCTIONS

The plan or sketch is to include:

- Size of tank(s) to be installed (water gallons)
- Distance from tank to property lines, existing buildings, streets, roads, and sidewalks. Overhead power lines, and all sources of ignition in all directions.
- Type of approved vehicle protection to be used.
 - Guard posts or other approved means of protection for tank and piping shall be provided.
~International Fire Code (IFC) (2018 Edition) Chapter 3 Section 312 and NFPA 58 (2017 Edition)
- Location of minimum 18 lb. B.C. fire extinguisher within 75 feet of dispenser.

PLAN REVIEW DRAWING

Submit to the Fire Marshal's Office: prevention@weberfiredistrict.gov.